

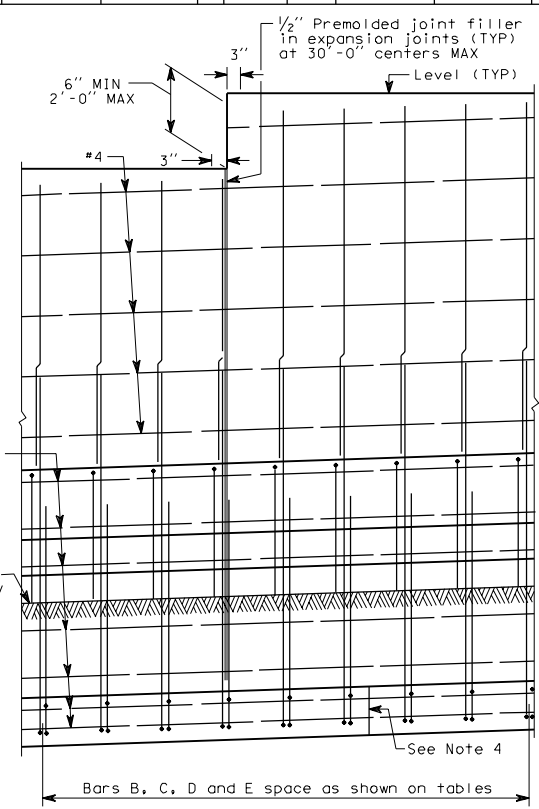


WALL HT H	TYPE 6A				W	X	BAR B and C		BAR D and E	W	X	BAR B and C		BAR D and E	W	X	BAR B and C		BAR D and E	WALL HT H
	W	X	BAR B and C	BAR D and E																
6'-0"	5'-6"	1"	#4 at 12"	#4 at 12"	5'-6"	1"	#4 at 12"	#4 at 12"	5'-6"	1"	1"	#4 at 12"	#4 at 12"	5'-6"	1"	1"	#4 at 12"	#4 at 12"	5'-6"	6'-0"
8'-0"	5'-3"	1"	#4 at 12"	#4 at 12"	5'-3"	1"	#4 at 12"	#4 at 12"	5'-3"	1"	1"	#4 at 12"	#4 at 12"	5'-3"	1"	1"	#4 at 12"	#4 at 12"	5'-3"	8'-0"
10'-0"	5'-3"	1"	#4 at 12"	#4 at 12"	5'-3"	1"	#4 at 12"	#4 at 12"	5'-3"	1"	1"	#4 at 12"	#4 at 12"	5'-3"	1"	1"	#4 at 12"	#4 at 12"	5'-3"	10'-0"
12'-0"	5'-0"	1"	#4 at 12"	#4 at 12"	5'-0"	1"	#4 at 12"	#4 at 12"	5'-0"	1"	1"	#4 at 12"	#4 at 12"	5'-0"	1"	1"	#4 at 12"	#4 at 12"	5'-0"	12'-0"
14'-0"	4'-9"	1"	#4 at 12"	#4 at 12"	5'-0"	1"	#4 at 11"	#4 at 11"	5'-0"	1"	1"	#4 at 12"	#4 at 12"	5'-0"	1"	1"	#4 at 12"	#4 at 12"	5'-0"	14'-0"
16'-0"	5'-0"	10"	#4 at 12"	#4 at 12"	5'-0"	10"	#4 at 10"	#4 at 10"	5'-0"	10"	10"	#4 at 10"	#4 at 10"	5'-0"	10"	10"	#4 at 10"	#4 at 10"	5'-0"	16'-0"
18'-0"	5'-0"	10"	#4 at 10"	#4 at 10"	5'-3"	1'-6"	#4 at 12"	#5 at 12"	5'-3"	1'-6"	1'-6"	#4 at 12"	#5 at 12"	5'-3"	1'-6"	1'-6"	#4 at 10"	#4 at 10"	5'-3"	18'-0"


- NOTES
1. Wall to be designated Noise Wall Type 6A, 6B, 6C and 6D. The Contract specifies actual wall designations.
 2. For intermediate wall heights not listed, use the next higher H.
 3. Panels shall have at least 3 feet of level ground on each side.
 4. Construction joints in the footing shall be spaced at 120 feet MAX.

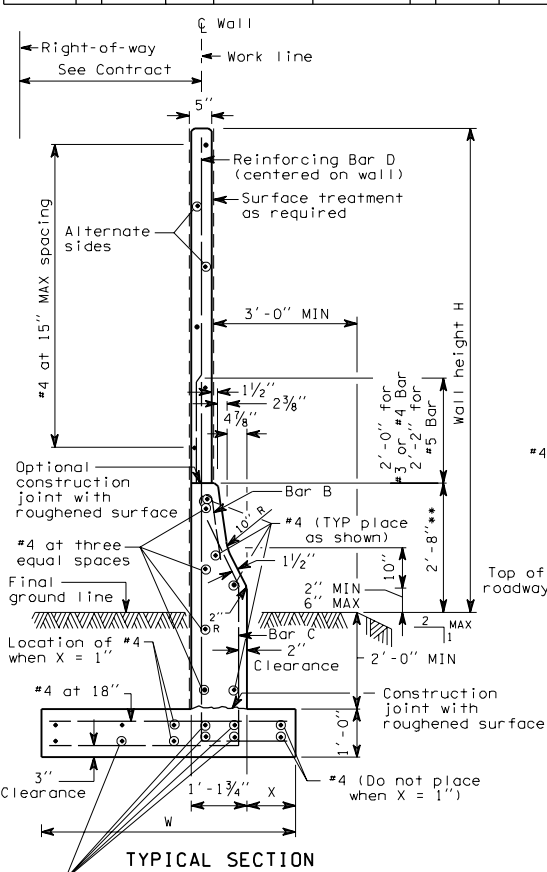


ELEVATION

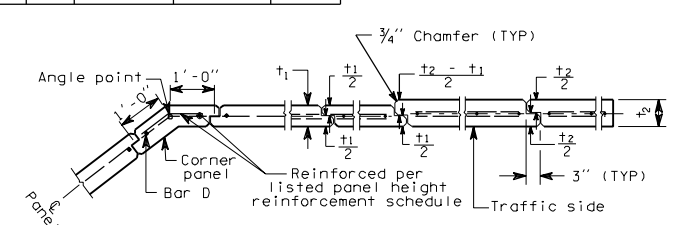

JOINT AND CORNER DETAIL

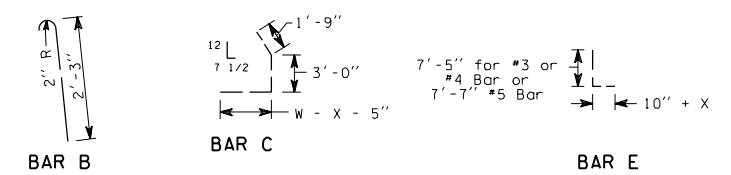

NOISE BARRIER - TYPE 6 CAST-IN-PLACE CONCRETE WALL WITH TRAFFIC BARRIER ON SPREAD FOOTING

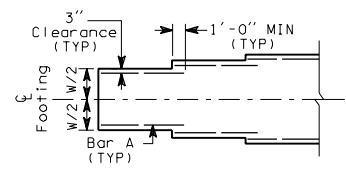

FOOTING WIDTH TRANSITION DETAIL
(For locations without footing step)